



C:\Work\Projects\23-47 St. Jude CC - Parish Hall Addn\Elec\2347-E21.dwg 12/21/23 10:30:28 Rene's ASUS

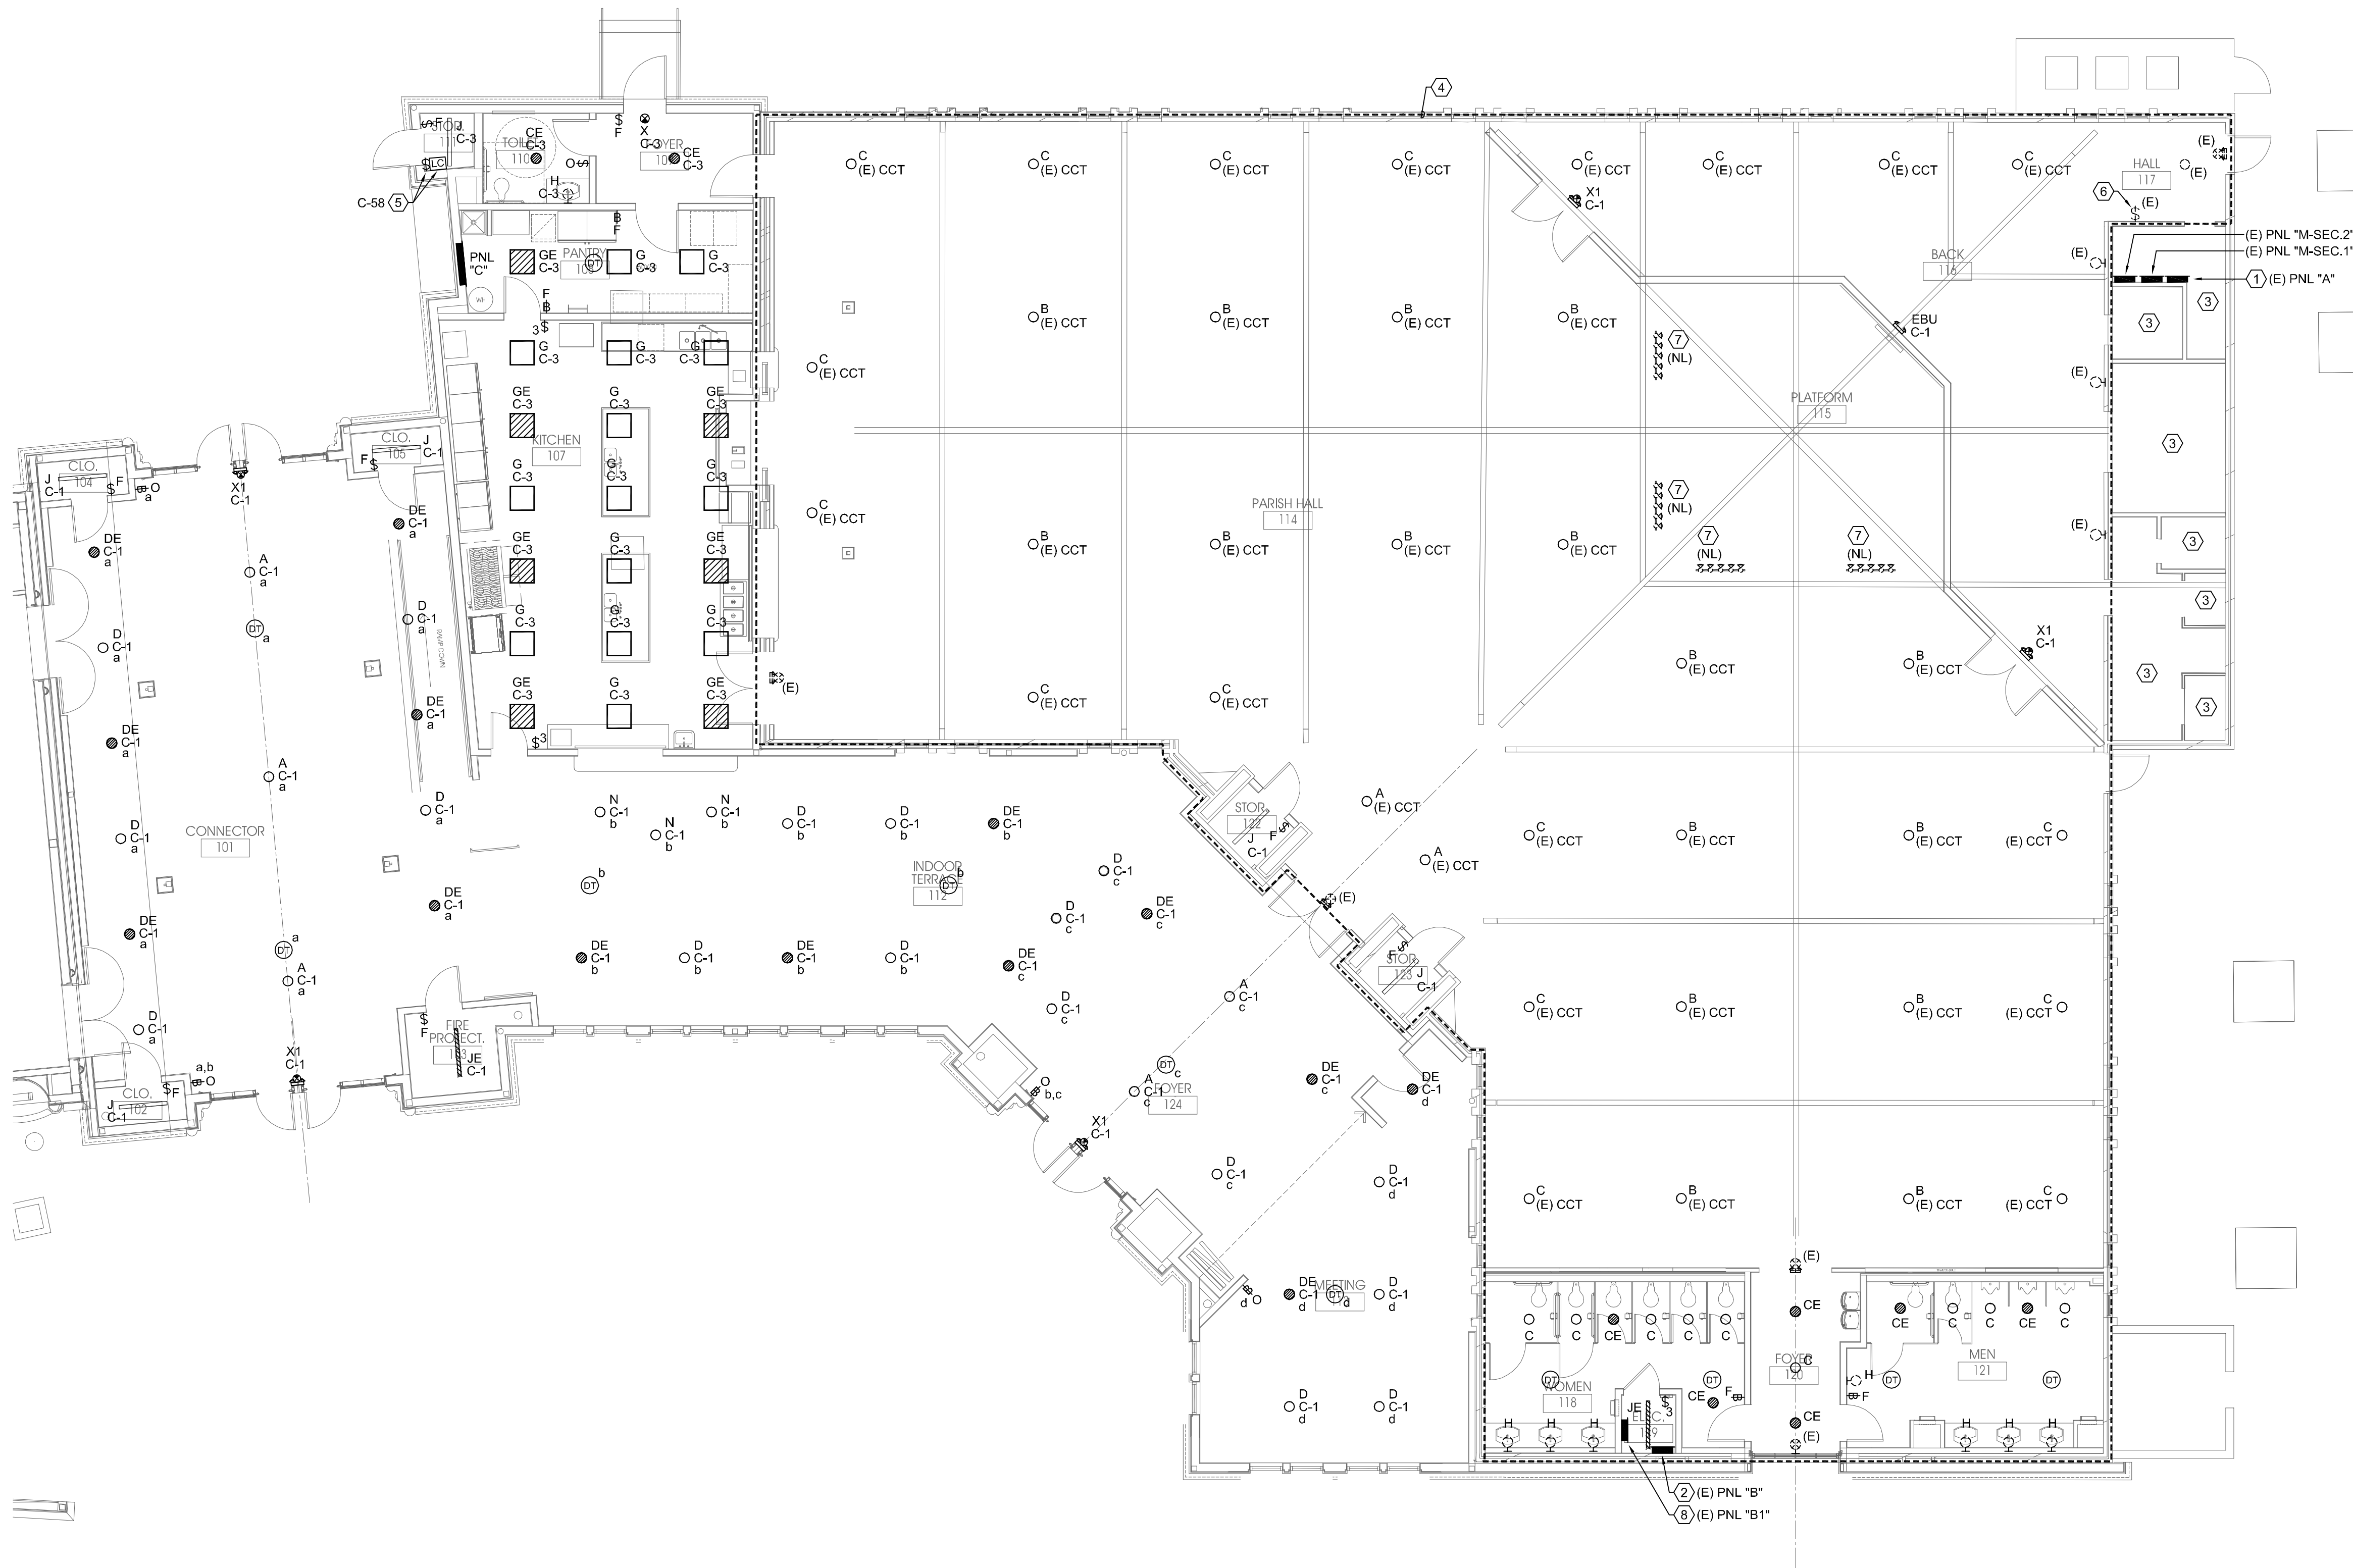

PARTIAL FLOOR - LIGHTING PLAN
Scale: 1/8" = 1'-0"


GENERAL NOTES

- RE: E0.1 FOR ELECTRICAL SYMBOLS, ADDITIONAL GENERAL NOTES, AND ABBREVIATIONS.
- RE: E0.2 FOR ELECTRICAL SPECIFICATIONS.
- RE: E0.3 FOR LIGHTING CONTROL DETAILS.
- RE: E5.1 FOR BRANCH WIRING SCHEDULE FOR WIRE SIZES.
- RE: E6.1 OR PANELBOARD SCHEDULES.
- RE: E7.1 FOR LIGHT FIXTURE SCHEDULE.
- RE: E7.1 FOR MECHANICAL / ELECTRICAL SCHEDULE.
- LIGHTING CONTROLS TO INCLUDE "DAYLIGHTING ZONE" REQUIREMENTS.
- PROVIDE ADDITIONAL CONDUCTOR WITHIN CIRCUITS WHERE REQUIRED FOR UNSWITCHED POWER TO EXIT SIGNS AND EMERGENCY BALLAST / DRIVER SYSTEMS.
- DESIGNATION REPRESENTS:
 - (E) EXISTING ELECTRICAL DEVICE TO REMAIN AS IS.
 - (R) EXISTING ELECTRICAL DEVICE TO BE REMOVED IN ITS ENTIRETY.
 - (RR) REMOVE AND RELOCATED EXISTING ELECTRICAL DEVICE.
 - (NL) NEW LOCATION FOR EXISTING RELOCATED ELECTRICAL DEVICE.
 - (CCT) EXISTING LIGHTING BRANCH CIRCUITING TO BE RE-USED FOR NEW LIGHT FIXTURES.

NOTES BY SYMBOL "#"

- EXISTING PANEL IS NOT LABELED. FOR DRAWING PURPOSES THIS EXISTING PANEL WILL BE IDENTIFIED AS "A".
- EXISTING PANEL IS NOT LABELED. FOR DRAWING PURPOSES THIS EXISTING PANEL WILL BE IDENTIFIED AS "B".
- NO ELECTRICAL WORK REQUIRED IN THIS ROOM. MAINTAIN LIGHTING AND POWER BRANCHING CIRCUITING CONTINUITY. EXISTING SWITCH TO REMAIN AS IS AND MAINTAIN SWITCHING CONFIGURATION. UNLESS NOTED OTHERWISE.
- RE-USE EXISTING LIGHTING BRANCH CIRCUITING TO RE-CONNECT TO NEW LIGHT FIXTURE(S) INDICATED.
- EXTERIOR LIGHTING CONTACTOR AND BY-PASS SWITCH. RE: 1/E0.3 EXTERIOR LIGHTING CONTACTOR WIRING DIAGRAM FOR ADDITIONAL INFORMATION.
- EXISTING LIGHT SWITCHES (TOTAL OF 27) ARE TO REMAIN AS IS. MAINTAIN CIRCUITING CONTINUITY AND SWITCHING CONFIGURATION.
- NEW LOCATION OF EXISTING RELOCATED TRACK LIGHTING. EXTEND EXISTING LIGHTING BRANCH CIRCUITING AND LIGHTING CONTROLS WITHIN A NEW EXPOSED CONDUIT AND RE-CONNECT. MAINTAIN CIRCUITING CONTINUITY AND SWITCHING CONFIGURATION. PAINT EXPOSED CONDUIT TO MATCH WOOD CEILING. COORDINATE COLOR WITH THE ARCHITECTS PRIOR TO PAINTING.

8' 0 8' 16'
1/8"=1'-0"



MEP Consultant
Rene A. Culross
Rene A. Culross, P.E., PLLC
1820 Hunting Green Drive
Fort Worth, TX 76134
817-798-6642
raculross@gmail.com
F-12230

ARCHITECTURE
SCOTT MARTSOLF - ARCHITECT

815 Daggett Avenue
Fort Worth, Texas 76104
Phone: (817) 820-0005

ST. JUDE
CATHOLIC
CHURCH

PARISH HALL
REMODEL &
CONNECTOR
BUILDING

500 E DALLAS ST.
MANSFIELD, TX 76063

BID SET

Drawing Title:

PARTIAL FLOOR -
LIGHTING PLAN

Project No.

2307

Date:

12/20/2023

Sheet No.

E2.1