

Approved plans in no way excludes items that may be found in the field and shall not be construed to be a permit or approval of any violation of any code provision.

815 Daggett Avenue
Fort Worth, Texas 76104

Phone: (817) 820-0005

Phone: (817) 820-0005

PARISH HALL REMODEL & CONNECTOR

500 E DALLAS ST.
MANSFIELD, TX 76063

1 12/29/23 ADDENDUM #1

Drawing Title:

PARTIAL FLOOR -
DEMOLITION PLAN


Project No. _____

2307

Date: _____

Sheet No.

E1.1



1 PARTIAL FLOOR - DEMOLITION PLAN

Scale: 1/8" = 1'-0"

19. EXISTING EXTERIOR LIGHT TO BE DISCONNECTED IN ITS ENTIRETY. DISCONNECT AND REMOVE EXISTING LIGHTING BRANCH CIRCUITING BACK TO ORIGIN (EXISTING EXTERIOR LIGHTING BRANCH CIRCUITING JUNCTION FEEDING OTHER EXTERIOR LIGHT FIXTURES REMAINING OR LIGHTING CONTROLS OR PANELBOARD).

20 EXISTING SURFACE MOUNTED RECEPTACLES ARE TO BE DISCONNECTED AND REMOVED. EXISTING EXPOSED CONDUIT AND ASSOCIATED CONDUCTORS ARE TO BE DISCONNECTED AND REMOVED BACK TO POINT OF ORIGIN (PANELBOARD).


16) EXISTING ELECTRICAL WATER COOLER TO BE DISCONNECTED AND RELOCATED. DISCONNECT AND MAKE SAFE THE EXISTING POWER BRANCH CIRCUITING (FIELD TRACE CCT B-11) TO BE RE-USED. RE: 1/E3.1 PARTIAL FLOOR - POWER AND DATA PLAN FOR ADDITIONAL INFORMATION.

17 EXISTING AIR HANDLER UNIT IS SCHEDULED FOR DEMOLITION. DISCONNECT, REMOVE EXISTING LOCAL DISCONNECTING MEANS, CONDUIT AND ASSOCIATED CONDUCTORS BACK TO THE POINT OF ORIGIN. LABEL EXISTING CIRCUIT BREAKER AS "SPARE".

18 EXISTING CONDENSING UNITS (2 TOTAL) IS SCHEDULED FOR DEMOLITION. DISCONNECT, REMOVE EXISTING LOCAL DISCONNECTING MEANS, CONDUIT AND ASSOCIATED CONDUCTORS BACK TO THE POINT OF ORIGIN. LABEL EXISTING CIRCUIT BREAKER AS "SPARE".

1. RE: E0.1 FOR ELECTRICAL SYMBOLS, ADDITIONAL GENERAL NOTES, AND ABBREVIATIONS.
2. RE: E0.2 FOR ELECTRICAL SPECIFICATIONS.
3. RE: E0.3 FOR LIGHTING CONTROL DETAILS
4. RE: E5.1 FOR BRANCH WIRING SCHEDULE FOR WIRE SIZES.
5. RE: E6.1 OR PANELBOARD SCHEDULES.
6. RE: E6.2 FOR LIGHT FIXTURE SCHEDULE.
7. RE: E6.2 FOR MECHANICAL / ELECTRICAL SCHEDULE.
8. LIGHTING CONTROLS TO INCLUDE "DAYLIGHTING ZONE" REQUIREMENTS.
9. PROVIDE ADDITIONAL CONDUCTOR WITHIN CIRCUITS WHERE REQUIRED FOR UNWITTING POWER TO EXIT SIGNS AND EMERGENCY BALLAST / DRIVER SYSTEMS.
10. EXISTING REPRESENTATIONS.
 - (E) EXISTING ELECTRICAL DEVICE TO REMAIN AS IS
 - (R) REMOVED ELECTRICAL DEVICE TO BE REMOVED IN ITS ENTIRETY.
 - (RR) REMOVE AND RELOCATED EXISTING ELECTRICAL DEVICE
 - (NL) NEW LOCATION FOR EXISTING RELOCATED ELECTRICAL DEVICE.
 - CCT EXISTING LIGHTING BRANCH CIRCUITING TO BE RE-USED FOR NEW LIGHT FIXTURES.

- ① EXISTING PANEL IS NOT LABELED. FOR DRAWING PURPOSES THIS EXISTING PANEL WILL BE IDENTIFIED AS "A".
- ② EXISTING PANEL IS NOT LABELED. FOR DRAWING PURPOSES THIS EXISTING PANEL WILL BE IDENTIFIED AS "B".
- ③ NO ELECTRICAL WORK REQUIRED IN THIS ROOM. MAINTAIN LIGHTING AND POWER BRANCHING CIRCUITING CONTINUITY. EXISTING SWITCH TO REMAIN AS IS AND MAINTAIN SWITCHING CONFIGURATION. UNLESS NOTED OTHERWISE.
- ④ CONTRACTOR TO TRACE ALL EXISTING LIGHTING AND BRANCH CIRCUITING TO DETERMINE WHICH CIRCUIT WILL BE RE-USED AND WHICH WILL BECOME "SPARES". PROVIDE NEW UPDATED PANELBOARD DIRECTORIES ONCE RENOVATION IS COMPLETED.
- ⑤ EXISTING EXTERIOR RECEPTACLES LOCATED ON THE EXISTING EXTERIOR WALLS ARE TO REMAIN AS IS. MAINTAIN EXISTING POWER BRANCH CIRCUITING.
- ⑥ EXISTING LIGHT FIXTURES DESIGNATED WITH (R) LTG WITHIN THE IS DASHED AREA ARE TO BE DISCONNECTED AND REMOVED IN ITS ENTIRETY. TURN LIGHT FIXTURES OVER TO THE OWNER FOR THEIR DISPOSAL.
- ⑦ EXISTING LIGHTING BRANCH CIRCUITING DESIGNATED WITH (E) OCT WITHIN THE DASHED AREA IS TO REMAIN AS IS. MAKE SURE FOR REUSE. RE: 1/1E2.1 PARTIAL FLOOR - LIGHTING PLAN FOR ADDITIONAL INFORMATION.
- ⑧ EXISTING INTERIOR RECEPTACLES LOCATED ON THE EXISTING EXTERIOR WALLS ARE TO REMAIN AS IS. MAINTAIN EXISTING POWER BRANCH CIRCUITING.
- ⑨ EXISTING DATA OUTLETS LOCATED ON THE EXISTING EXTERIOR WALLS ARE TO REMAIN AS IS. MAINTAIN EXISTING COMMUNICATION CABLEING CONTINUITY.
- ⑩ EXISTING MECHANICAL UNITS (AHU'S AND CONDENSING UNITS) ARE EXISTING TO REMAIN AS IS UNLESS NOTED OTHERWISE. EXISTING POWER BRANCH CIRCUITING TO REMAIN AS IS AND MAINTAIN EXISTING POWER BRANCH CIRCUITING CONTINUITY.
- ⑪ EXISTING FIRE ALARM DEVICE(S) LOCATED WITHIN THE DASHED AREA ARE EXISTING TO REMAIN AS IS. EXISTING MAINTAIN FIRE ALARM CONTINUITY BACK TO EXISTING CONTROL PANEL(S). EXISTING FIRE ALARM CONTROL PANEL(S) ARE TO BE DISCONNECTED AND RELOCATED. DISCONNECT AND MAKE SAFE THE EXISTING POWER BRANCH CIRCUITING (FIELD TRAC OCT E-11) TO BE RE-USED. RE: 1/1E3.1 PARTIAL FLOOR - POWER AND DATA PLAN FOR ADDITIONAL INFORMATION.
- ⑫ EXISTING TRACK LIGHTING IS TO BE DISCONNECTED AND RELOCATED. EXISTING LIGHTING BRANCH CIRCUITING TO BE MADE SAFE FOR FUTURE USE. RE: 1/2.1 PARTIAL FLOOR - LIGHTING PLAN FOR ADDITIONAL INFORMATION.

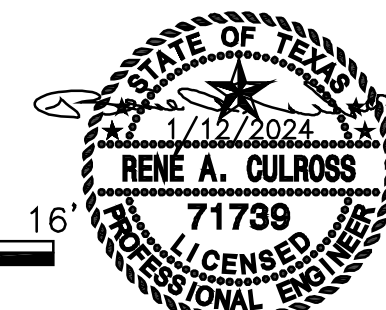

MEP Consultant
Rene' A. Culross
Rene' A. Culross, P.E., PLLC
1820 Hunting Green Drive
Fort Worth, TX 76134
817-798-6642
raculross@gmail.com
F-12230

2347.0115.8824